

Sloped roof

Louvered vent

TITLE		PWH601 Grey	
DRAWN BY	J. Ellison	DATE	18/01/2022
CUSTOMER	CUSTOMER		

Foundation Requirements:	
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.	
ALL DIMENSIONS+/- 5mm UNLESS OTHERWISE STATED	A4


DESCRIPTION:	PWH601 c/w Louvered vent
ALL DIMENSIONS IN MM - DO NOT SCALE	

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1000 x 500 x 1200mm
EXTERNAL DIMENSIONS	1150 x 650 x 1280mm
NOM. CAPACITY	600 Litres
DRY WEIGHT	50 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:20 SHEET 1 OF 2

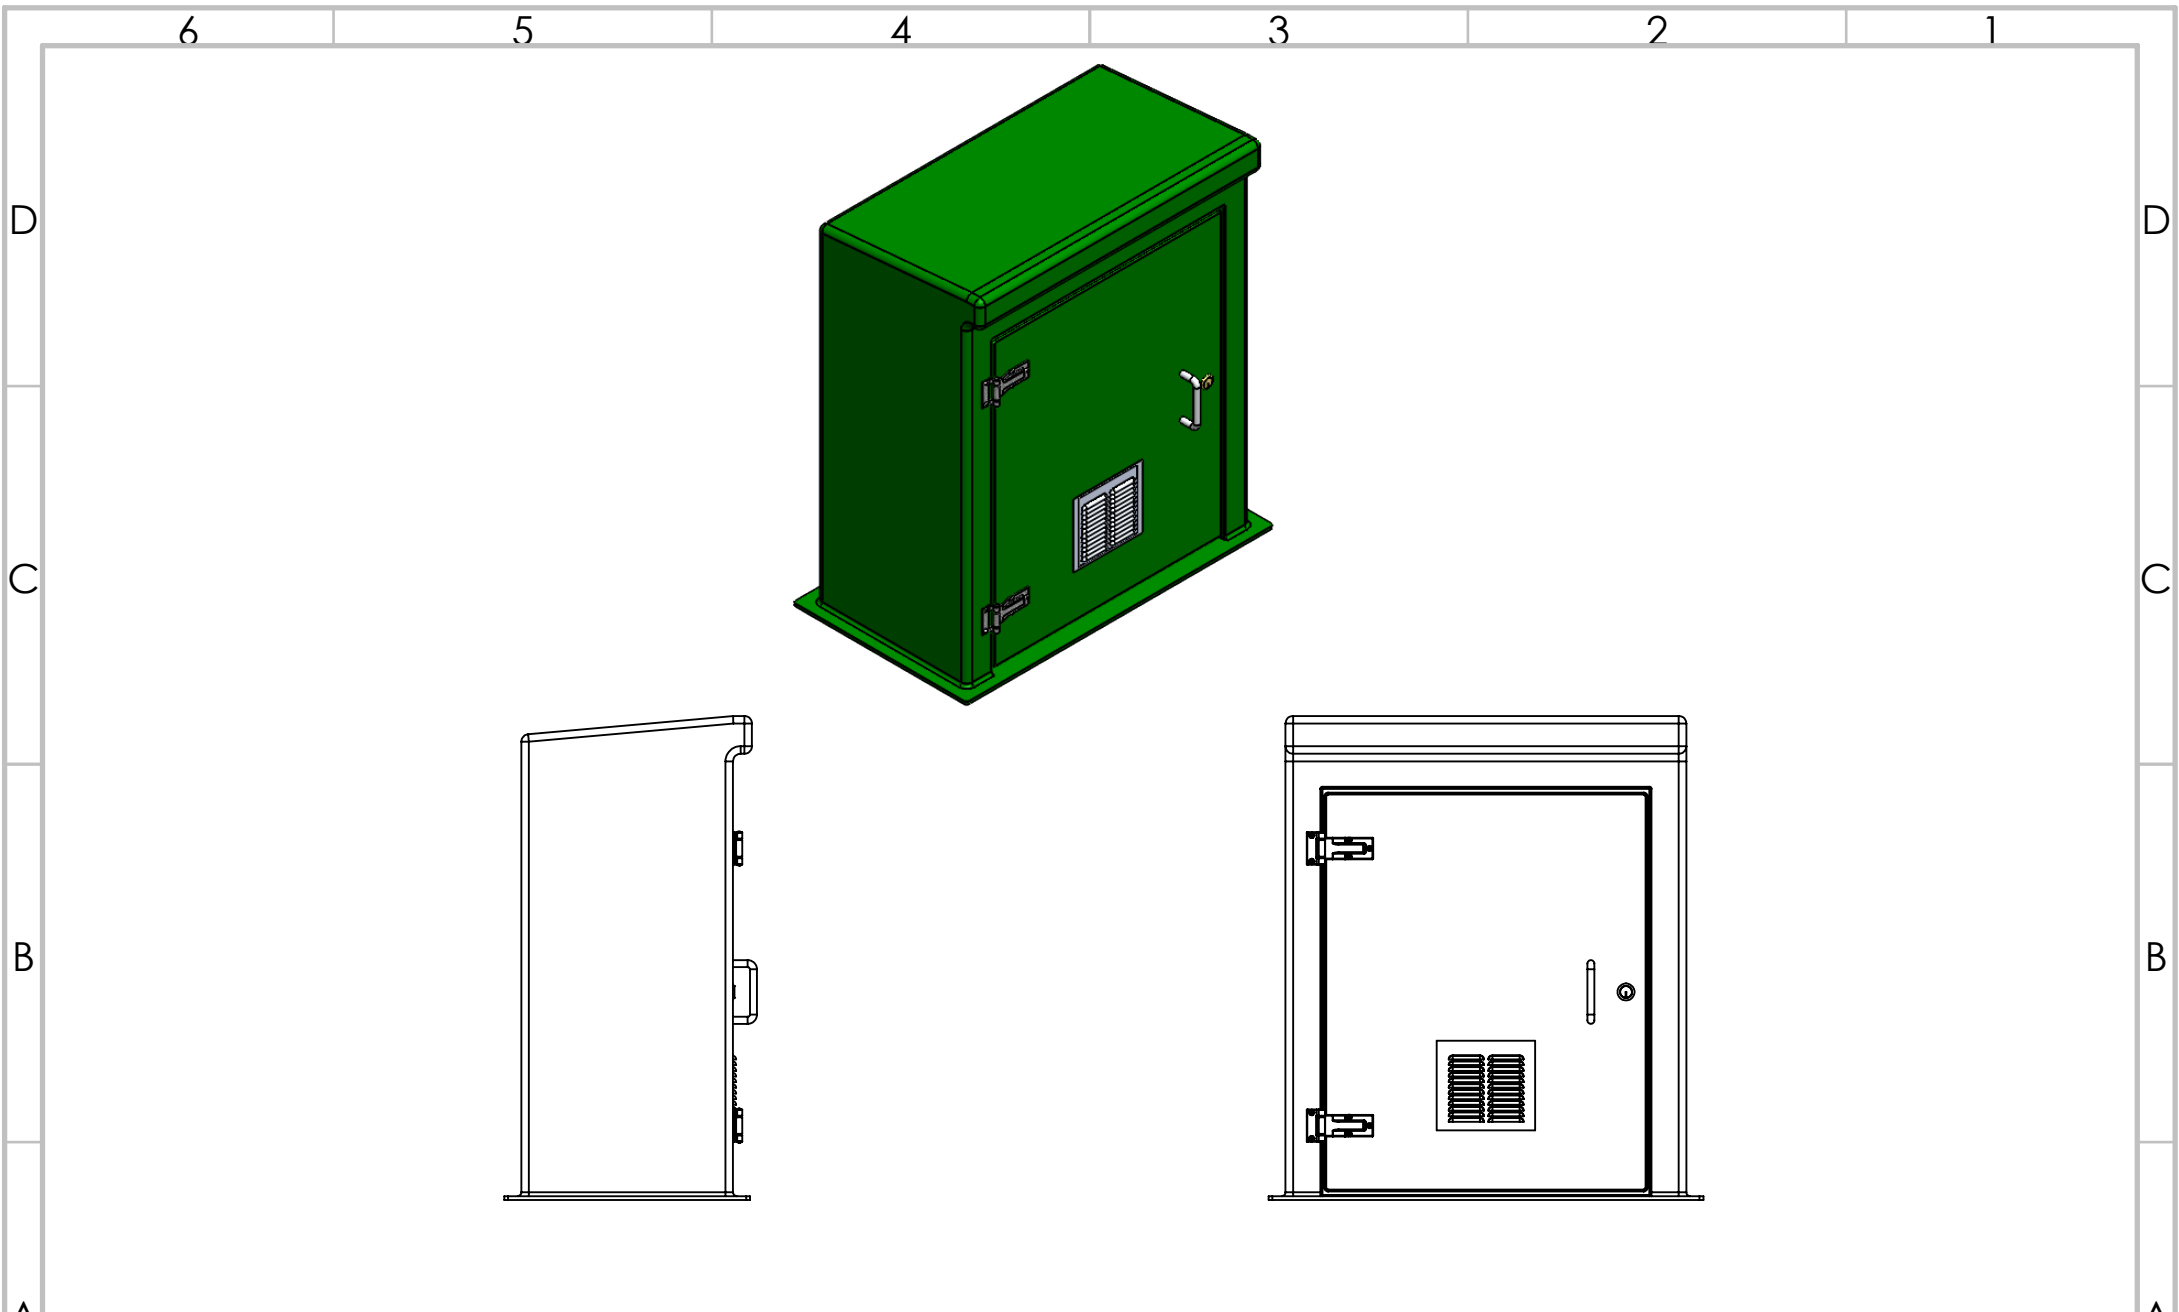

TITLE
PWH601 Green

DRAWN BY
J. Ellison

DATE
18/01/2022

CUSTOMER
CUSTOMER

Foundation Requirements:
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm
UNLESS OTHERWISE STATED

DESCRIPTION:
PWH601 c/w Louvered vent

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
21/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1000 x 500 x 1200mm
EXTERNAL DIMENSIONS	1150 x 650 x 1280mm
NOM. CAPACITY	600 Litres
DRY WEIGHT	50 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:20

SHEET 2 OF 2