
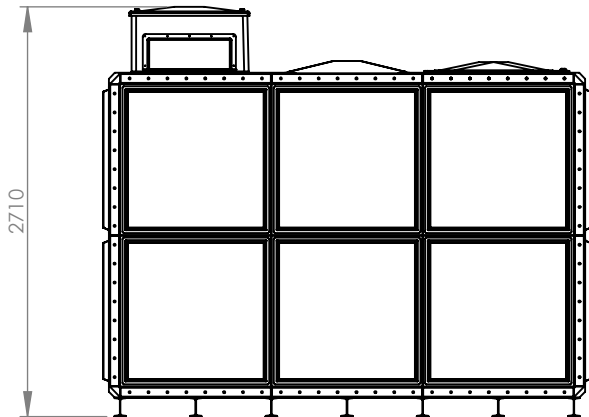


Internal central division

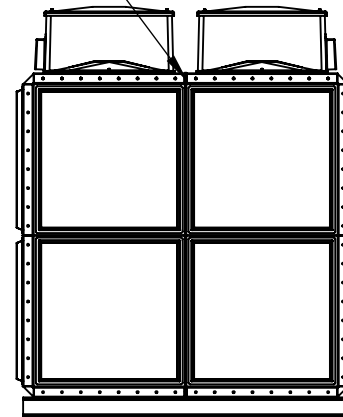

TITLE  
PW.3x2x2.TIF.DIV.AB

NOTE:  
Tanks Direct sectional tanks must be fully supported on a flat, level & continuous foundation which provides structural support to the tank when full to a maximum capacity. It is essential that the installer and/or user refers to the conditions of the installation document prior to the installation of the tank. Under no circumstances should any part of the tank structure be used to provide support to pipework and/or any ancillary items.

DESCRIPTION:  
PW.3x2x2.TIF.DIV Sectional cold water storage tank c/w raised float valve housings to provide an AB Air gap

DATE	VERSION	NOTES
23/01/2023	A	FIRST ISSUE

TANK SPECIFICATION :

INTERNAL DIMENSIONS	3150 x 2150 x 2150mm
EXTERNAL DIMENSIONS	3224 x 2234 x 2710mm
NOM. CAPACITY	14,560 Litres
INSULATION THICKNESS	38mm
MATERIAL	Hot press moulded GRP



DRAWN BY J. Ellison DATE 01/02/2023

CUSTOMER CUSTOMER

ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

SCALE:1:50

SHEET 1 OF 1