
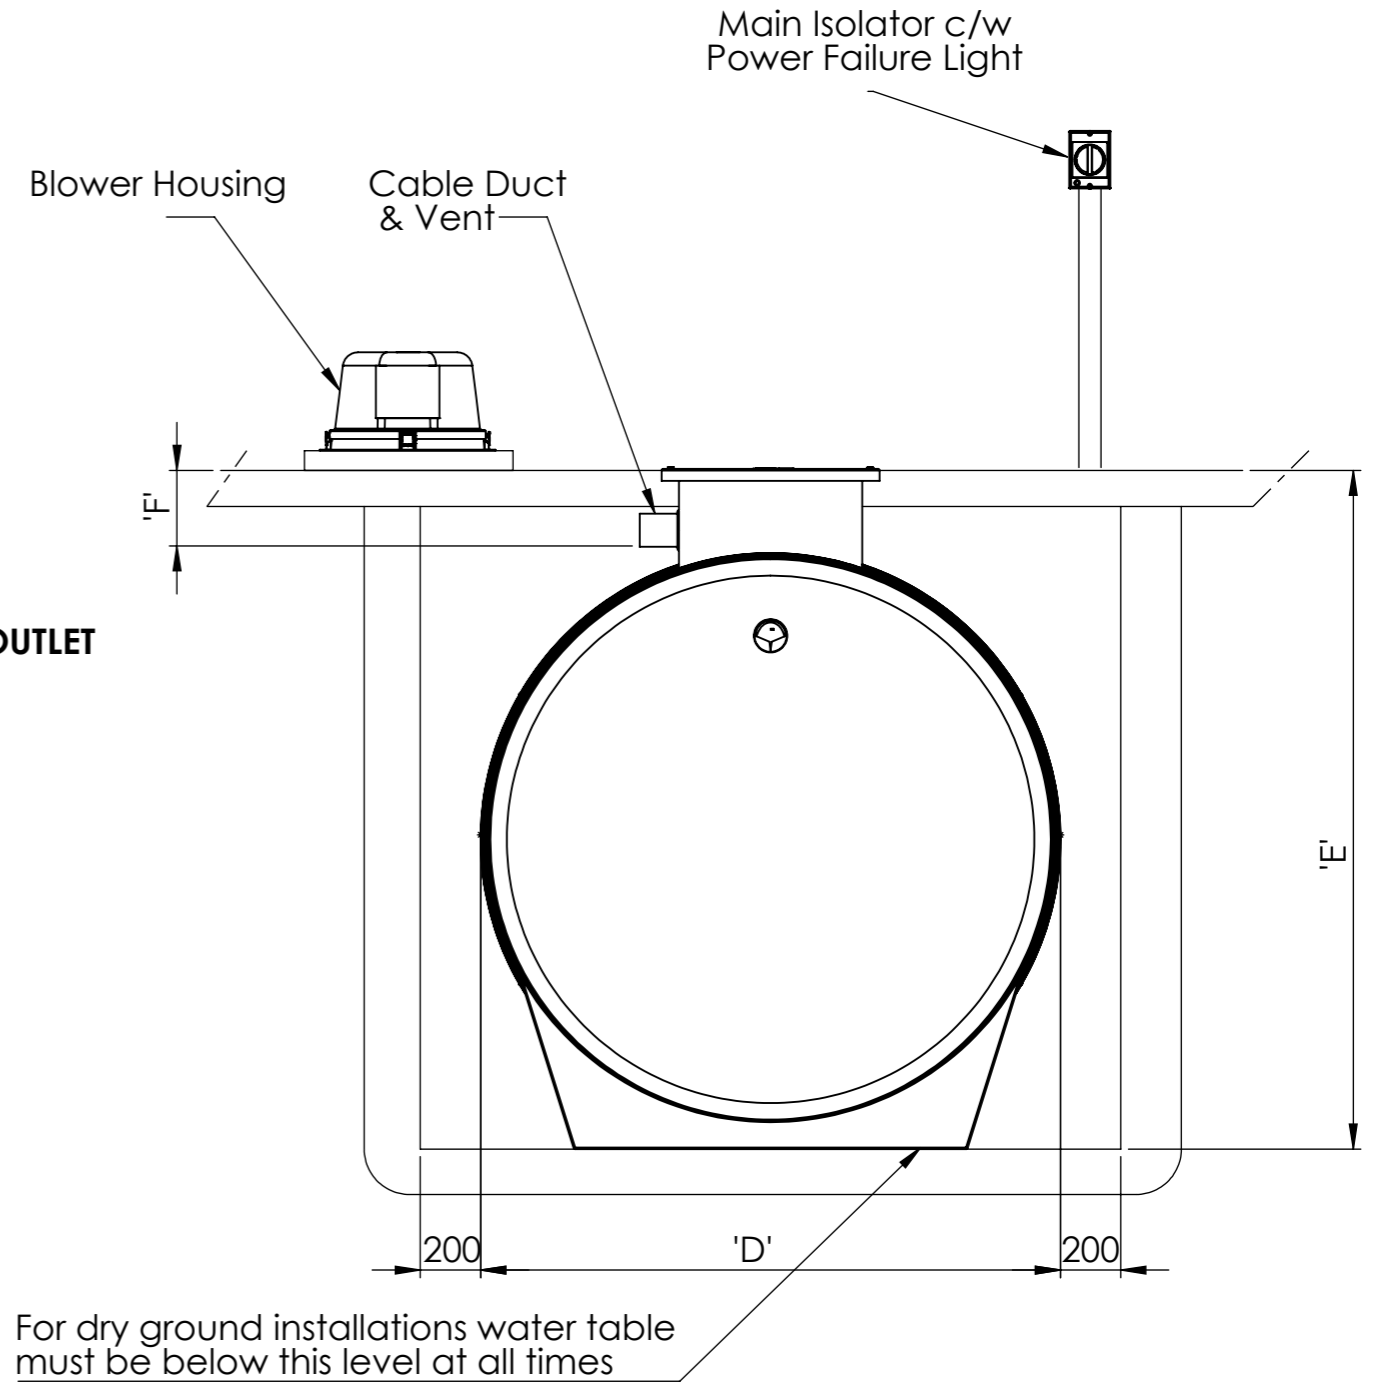


Notes:

1. This drawing is for 'Dimensional information Only', it is essential that this drawing is read in conjunction with the 'Installation Guidelines' supplied with the unit. (Copies available from our Sales Department)
2. Inlet and Outlet pipes are Ø110mm PVCu.
3. Extension neck kit is available for deep inverts up to a maximum invert of 2000mm. See extension neck drawing for assembly details.
4. Blower located inside external housing. Alarm beacon to be fitted to outside of blower housing (if applicable).
5. Vent pipe connection is supplied but vent runs and stacks are supplied by others.
6. Air hose for tank internals is supplied with blower housing and is run through the vent.
7. **Pea -shingle backfill is reliant on use of correct strapping and anchoring.

| Unit Ref | A' (mm) | B' (mm) | C' (mm) | D' (mm) | E' (mm) | F' (mm) | G' (mm) | Unit Weight (Kgs) |
|----------|---------|---------|---------|---------|---------|---------|---------|-------------------|
| BIA 4 | 500 | 600 | 3238 | 1920 | 2245 | 250 | 110 | 360 |
| | 1000 | 1100 | 3238 | 1920 | 2745 | 250 | 110 | 370 |
| | 1500 | 1600 | 3238 | 1920 | 3245 | 250 | 110 | 400 |
| | 2000 | 2100 | 3238 | 1920 | 3745 | 250 | 110 | 410 |

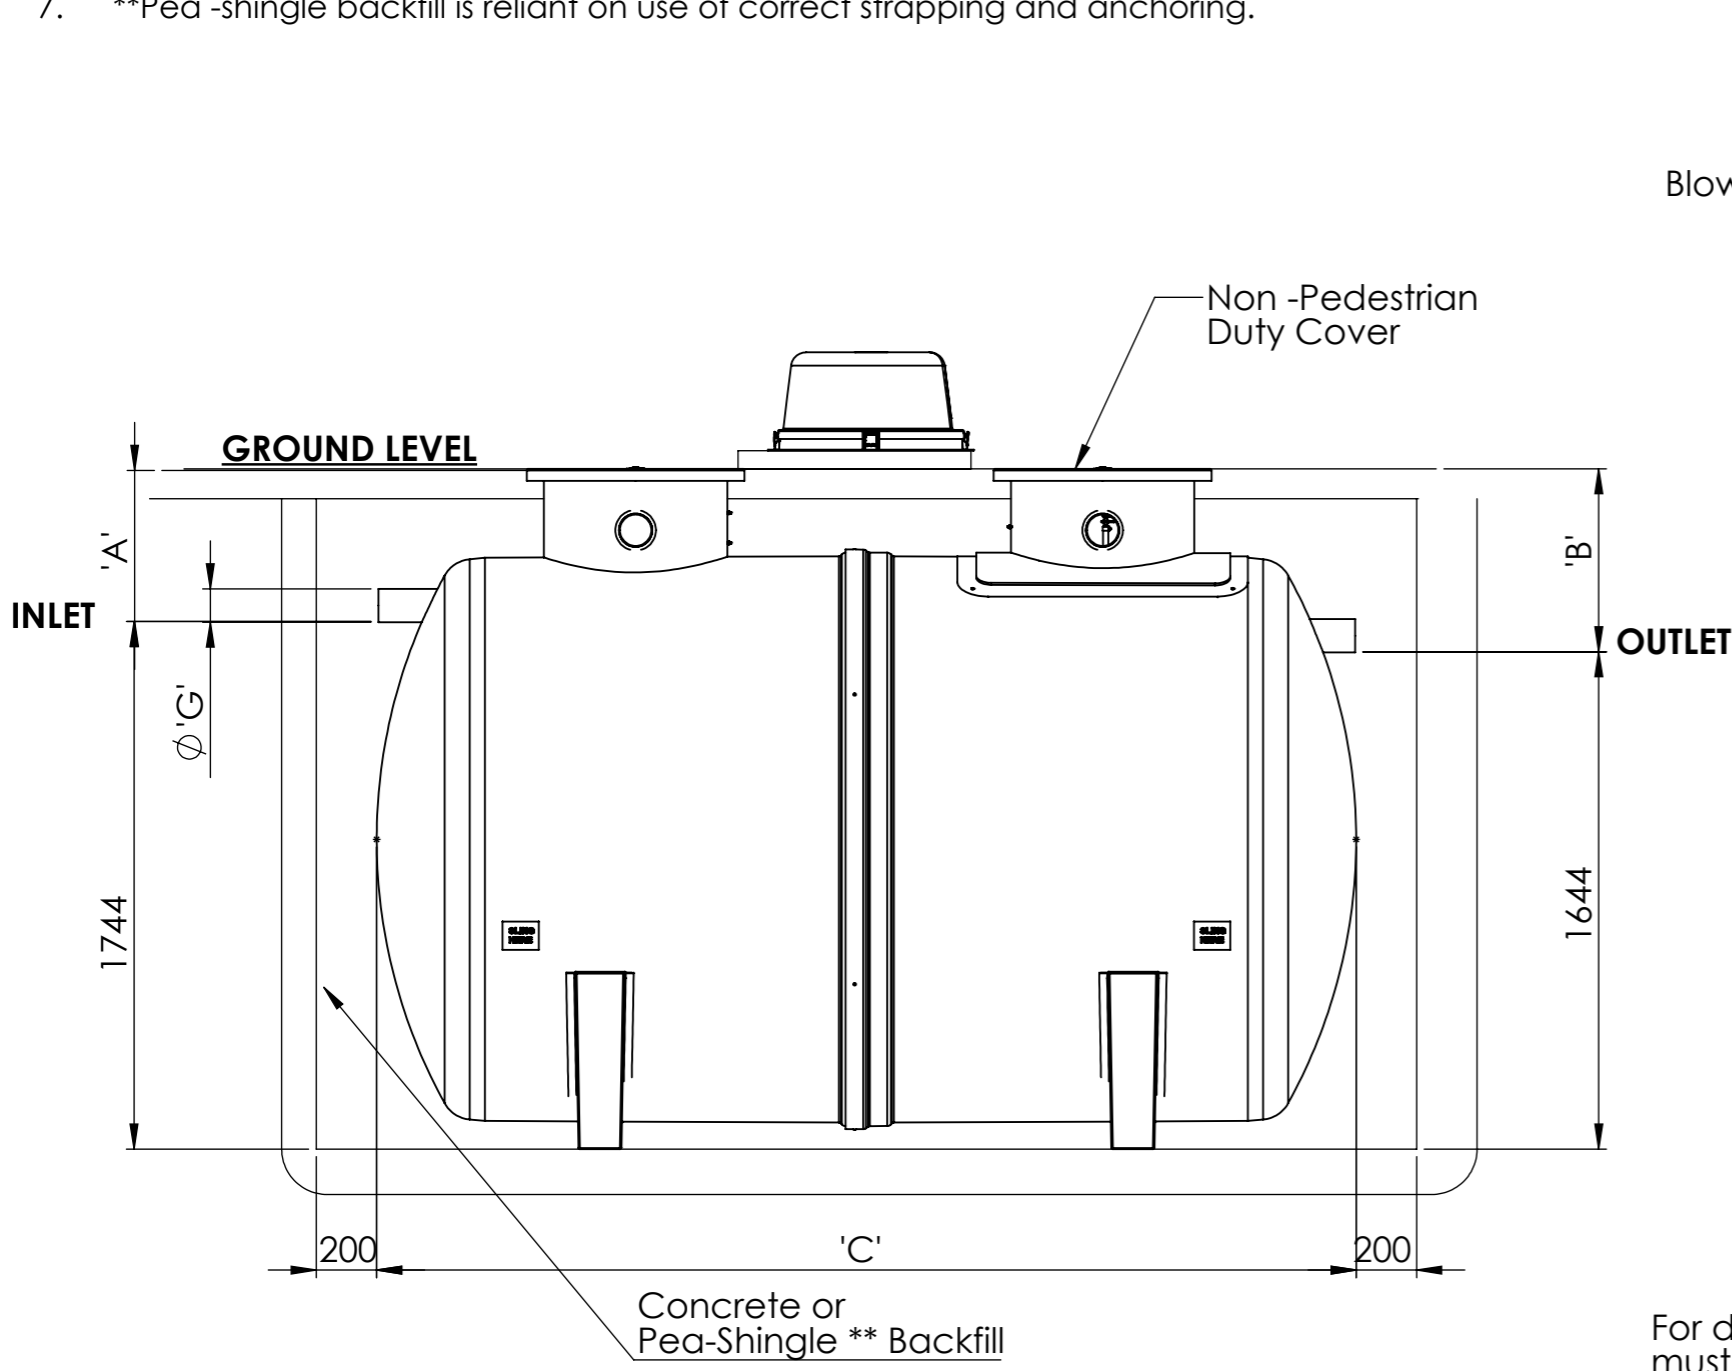

| Please check with Kingspan Water & Energy for the latest Issue of the drawing | | | | |
|---|------------|----------|-------------|---------------|
| Issue | Date | Drawn By | Approved By | Description |
| 01 | 19/01/2024 | JMcM | JMcM | Initial Issue |

| | |
|------------------------|----------------------|
| LN Number :1012958 | Tolerance : +/- 5 mm |
| Finish : n/a | Thickness : n/a |
| Weight : See Table Kgs | Surface Area : n/a |
| Modelled By : | Material : Various |

Drawing : DS1446B Page 1 of 1
 BioAir 4 (12PE) Gravity Sales Drawing

All dimensions in mm Scale: Not to scale

Clearwater reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Clearwater.

